



MALAYSIAN STANDARD

MS 2489-1:2012

**Respiratory protective devices - Compressed
air line breathing apparatus with demand
valve - Part 1: Apparatus with a full face mask
- Requirements, testing, marking**

ICS: 13.340.30

Descriptors: respiratory protective equipment, accident prevention, compressed air line breathing apparatus, demand valve, full mask, specifications, tests, marking

FOR SALE WITHIN MALAYSIA ONLY

© Copyright 2012

DEPARTMENT OF STANDARDS MALAYSIA

DEVELOPMENT OF MALAYSIAN STANDARDS

The **Department of Standards Malaysia (STANDARDS MALAYSIA)** is the national standards and accreditation body of Malaysia.

The main function of STANDARDS MALAYSIA is to foster and promote standards, standardisation and accreditation as a means of advancing the national economy, promoting industrial efficiency and development, benefiting the health and safety of the public, protecting the consumers, facilitating domestic and international trade and furthering international cooperation in relation to standards and standardisation.

Malaysian Standards (MS) are developed through consensus by committees which comprise balanced representation of producers, users, consumers and others with relevant interests, as may be appropriate to the subject at hand. To the greatest extent possible, Malaysian Standards are aligned to or are adoption of international standards. Approval of a standard as a Malaysian Standard is governed by the Standards of Malaysia Act 1996 [Act 549]. Malaysian Standards are reviewed periodically. The use of Malaysian Standards is voluntary except in so far as they are made mandatory by regulatory authorities by means of regulations, local by-laws or any other similar ways.

STANDARDS MALAYSIA has appointed **SIRIM Berhad** as the agent to develop, distribute and sell the Malaysian Standards.

For further information on Malaysian Standards, please contact:

Department of Standards Malaysia
Ministry of Science, Technology and Innovation
Level 1 & 2, Block 2300, Century Square
Jalan Usahawan
63000 Cyberjaya
Selangor Darul Ehsan
MALAYSIA

Tel: 60 3 8318 0002
Fax: 60 3 8319 3131
<http://www.standardsmalaysia.gov.my>

E-mail: central@standardsmalaysia.gov.my

OR **SIRIM Berhad**
(Company No. 367474 - V)
1, Persiaran Dato' Menteri
Section 2, P.O.Box 7035
40700 Shah Alam
Selangor Darul Ehsan
MALAYSIA

Tel: 60 3 5544 6000
Fax: 60 3 5510 8095
<http://www.sirim.my>

E-mail: msonline@sirim.my

Committee representation

The Industry Standards Committee on Occupational Safety and Health (ISC W) under whose authority this Malaysian Standard was adopted, comprises representatives from the following organisations:

Business Council for Sustainable Development Malaysia
Chemical Industries Council of Malaysia
Construction Industry Development Board Malaysia
Department of Agriculture
Department of Chemistry, Malaysia
Department of Environment
Department of Occupational Safety and Health Malaysia
Department of Standards Malaysia
Federation of Malaysian Manufacturers
Jabatan Bomba dan Penyelamat Malaysia
Lloyd's Register Technical Services Sdn Bhd
Malaysian Employers Federation
Malaysian Industrial Hygiene Association
Malaysian International Chambers of Commerce and Industry
Malaysian Nuclear Agency
Malaysian Society for Occupational Safety and Health
Malaysian Trades Union Congress
Minerals and Geoscience Department Malaysia
Ministry of Health Malaysia
Ministry of International Trade and Industry
National Institute of Occupational Safety and Health
SIRIM Berhad (Secretariat)
SIRIM QAS International Sdn Bhd
SME Corporation Malaysia
Suruhanjaya Tenaga
The Institution of Engineers, Malaysia
Universiti Kebangsaan Malaysia

The Technical Committee on Personal Safety - Protective Clothing and Equipment for Occupational Use which recommended the adoption of the EN Standard as Malaysian Standard consists of representatives from the following organisations:

3M Malaysia Sdn Bhd
Construction Industry Development Board Malaysia
Department of Chemistry, Malaysia
Department of Occupational Safety and Health Malaysia
Malaysian Nuclear Agency
National Institute of Occupational Safety and Health
PETRONAS Carigali Sdn Bhd
ProGuard Technologies (M) Sdn Bhd
Projek Lebuhraya Utara-Selatan Berhad
Science and Technology Research Institute for Defence
SIRIM Berhad (Secretariat)
SIRIM QAS International Sdn Bhd

Co-opted member:

Jabatan Bomba dan Penyelamat Malaysia

NATIONAL FOREWORD

The adoption of the EN Standard as a Malaysian Standard was recommended by the Technical Committee on Personal Safety - Protective Clothing and Equipment for Occupational Use under the authority of the Industry Standards Committee on Occupational Safety and Health.

This Malaysian Standard is identical with EN 14593-1:2005, *Respiratory protective devices - Compressed air line breathing apparatus with demand valve - Part 1: Apparatus with a full face mask - Requirements, testing, marking*, published by the European Committee for Standardization (CEN). However, for the purposes of this Malaysian Standard, the following apply:

- a) in the source text, "this European Standard" should read "this Malaysian Standard";
- b) the comma which is used as a decimal sign (if any), to read as a point;
- c) In Clause 2, replace "EN 50020, *Electrical apparatus for potentially explosive atmospheres - Intrinsic safety "i"*" with "EN 60079-11, *Explosive atmospheres - Equipment protection by intrinsic safety "i"*";
- d) remove "Annex ZA", which is not applicable to Malaysia; and
- e) reference to European Standards should be replaced by corresponding Malaysian Standards as follows:

Referenced European Standards

EN 132, *Respiratory protective devices - Definitions of terms and pictograms*

EN 134, *Respiratory protective devices - Nomenclature of components*

EN 136, *Respiratory protective devices - Full face masks - Requirements, testing, marking*

EN 137, *Respiratory protective devices - Self-contained open-circuit compressed air breathing apparatus - Requirements, testing, marking*

EN 60079-11, *Explosive atmospheres - Equipment protection by intrinsic safety "i"*

EN 60079-0, *Electrical apparatus for explosive gas atmospheres - Part 0: General requirements*

Corresponding Malaysian Standards

MS 2483, *Respiratory protective devices - Definitions of terms and pictograms*

MS 2485, *Respiratory protective devices - Nomenclature of components*

MS 2486, *Respiratory protective devices - Full face masks - Requirements, testing, marking*

MS 2487, *Respiratory protective devices - Self-contained open-circuit compressed air breathing apparatus - Requirements, testing, marking*

MS IEC 60079-11, *Explosive atmospheres - Equipment protection by intrinsic safety "i"*

MS IEC 60079-0, *Electrical apparatus for explosive gas atmospheres - Part 0: General requirements*

NATIONAL FOREWORD *(continued)*

MS 2489 consists of the following parts, under the general title *Respiratory protective devices - Compressed air line breathing apparatus with demand valve*:

Part 1: Apparatus with a full face mask - Requirements, testing, marking

Part 2: Apparatus with a half mask at positive pressure - Requirements, testing, marking

This standard is published with the permission of the European Committee for Standardization. Such permission is hereby acknowledged.

Compliance with a Malaysian Standard does not of itself confer immunity from legal obligations.

ICS 13.340.30

English version

Respiratory protective devices - Compressed air line breathing apparatus with demand valve - Part 1: Apparatus with a full face mask - Requirements, testing, marking

Appareils de protection respiratoire - Appareils de protection respiratoire isolants à adduction d'air comprimé avec soupape à la demande - Partie 1: Appareil avec masque complet - Exigences, essais, marquage

Atemschutzgeräte - Druckluft-Schlauchgeräte mit Lungenautomat - Teil 1: Geräte mit einer Vollmaske - Anforderungen, Prüfung, Kennzeichnung

This European Standard was approved by CEN on 15 March 2005.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	Page
Foreword.....	4
Introduction	5
1 Scope	5
2 Normative references	5
3 Terms, definitions and pictograms	6
4 Description	6
5 Requirements	7
5.1 General.....	7
5.2 Ergonomics	7
5.3 Materials	7
5.4 Water immersion.....	7
5.5 Cleaning and disinfecting	7
5.6 Practical performance	8
5.7 Connections	8
5.8 Compressed air line breathing apparatus used with self-contained breathing apparatus - switch over device.....	9
5.9 Body harness or belt	10
5.10 Performance requirements after storage	10
5.11 Flammability	10
5.12 Resistance to pressure	11
5.13 Mobile high pressure air supply systems	11
5.14 Warning devices for mobile high pressure air supply systems	11
5.15 Compressed air supply tube	12
5.16 Breathing hose.....	13
5.17 Lung governed demand valve	13
5.18 Adjustable parts.....	14
5.19 Full face masks	14
5.20 Inward leakage	14
5.21 Inhalation and exhalation valves.....	14
5.22 Breathing resistance	15
5.23 Carbon dioxide content of inhalation air.....	15
5.24 Leaktightness.....	15
6 Testing	16
6.1 General.....	16
6.2 Water immersion.....	17
6.3 Visual inspection	17
6.4 Practical performance	17
6.5 Strength of connections to facepiece, demand valve, medium pressure connecting tube and breathing hose.....	19
6.6 Resistance to collapse of breathing hose.....	19
6.7 Strength of compressed air supply tube, body harness and couplings.....	19
6.8 Storage conditioning.....	19
6.9 Flammability	20
6.10 Pressure relief valve	20
6.11 Resistance to kinking of compressed air supply tube	20
6.12 Resistance to collapse of compressed air supply tube.....	20
6.13 Heat resistance of compressed air supply tube.....	21

6.14 Inward leakage.....21

6.15 Tests for lung-governed demand valve21

6.16 Determination of carbon dioxide content of the inhalation air.....22

6.17 Testing of audible warning device.....22

6.18 Switch over device22

7 Marking.....22

8 information supplied by the manufacturer23

Annex A (normative) Static and dynamic pressure for apparatus with thread connector in accordance with EN 148-331

Annex B (informative) Marking33

Annex ZA (informative) Relationship between this European Standard and the Essential Requirements of EU Directive 89/686/EEC (PPE).....34

Preview Only

Foreword

This European Standard (EN 14593-1:2005) has been prepared by Technical Committee CEN/TC 79 "Respiratory protective devices", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2005, and conflicting national standards shall be withdrawn at the latest by October 2005.

This European Standard has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive 89/686/EEC.

For relationship with EU Directive, see informative Annex ZA, which is an integral part of this European Standard.

Together with EN 14593-2 and EN 14594, this European Standard supersedes EN 139:1994.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

Introduction

A given respiratory protective device can only be approved when the individual components satisfy the requirements of the test specification, which may be a complete standard or part of a standard, and practical performance tests have been carried out successfully on complete apparatus where specified in the appropriate standard. If for any reason a complete apparatus is not tested then simulation of the apparatus is permitted provided the respiratory characteristics and weight distribution are similar to those of the complete apparatus.

1 Scope

This European Standard specifies minimum requirements for compressed air line breathing apparatus with demand valve for use with a full face mask as a respiratory protective device. Escape and diving apparatus and apparatus used in abrasive blasting operations without additional protective features are not covered by this European Standard, although certain requirements addressing the use in conjunction with escape apparatus and escape conditions are given.

Laboratory and practical performance tests are included for the assessment of conformance to the requirements.

2 Normative references

The following referenced documents are indispensable for the application of this European Standard. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 132:1998, *Respiratory protective devices — Definitions of terms and pictograms*

EN 134:1998, *Respiratory protective devices — Nomenclature of components*

EN 136:1998, *Respiratory protective devices — Full face masks — Requirements, testing, marking*

prEN 137:2002, *Respiratory protective devices — Self-contained open-circuit compressed air breathing apparatus with full face mask — Requirements, testing, marking*

EN 148-1, *Respiratory protective devices — Threads for facepieces — Part 1: Standard thread connection*

EN 148-2, *Respiratory protective devices — Threads for facepieces — Part 2: Centre thread connection*

EN 148-3, *Respiratory protective devices — Threads for facepieces — Part 3: Thread connection M45 x 3*

EN 402:2003, *Respiratory protective devices — Lung governed demand self-contained open-circuit compressed air breathing apparatus with full face mask or mouthpiece assembly for escape — Requirements, testing, marking*

EN 12021, *Respiratory protective devices — Compressed air for breathing apparatus*

EN 13274-1:2001, *Respiratory protective devices — Methods of test — Part 1: Determination of inward leakage and total inward leakage*

EN 13274-2:2001, *Respiratory protective devices — Methods of test — Part 2: Practical performance tests*

EN 14593-1:2005 (E)

EN 13274-3, *Respiratory protective devices — Methods of test — Part 3: Determination of breathing resistance*

EN 13274-4, *Respiratory protective devices — Methods of test — Part 4: Flame tests*

EN 13274-6, *Respiratory protective devices — Methods of test — Part 6: Determination of carbon dioxide content of the inhalation air*

EN 50020, *Electrical apparatus for potentially explosive atmospheres — Intrinsic safety "i"*

EN 60079-0, *Electrical apparatus for explosive gas atmospheres — Part 0: General requirements (IEC 60079-0:2004)*

EN ISO 8031, *Rubber and plastics hoses and hose assemblies — Determination of electrical resistance (ISO 8031:1993)*

3 Terms, definitions and pictograms

For the purposes of this European Standard, the terms, definitions and pictograms given in EN 132:1998, EN 134:1998 and the following apply.

3.1

compressed air line breathing apparatus with a demand valve for use with a full face mask

apparatus, which is not self-contained, in which the wearer is supplied with breathable air from a source of compressed air at a maximum pressure of 10 bar

3.2

facepiece

full face mask conforming to EN 136 (Class 2 or Class 3)

3.3

mobile high pressure air supply system

supply system that may include a compressor, filters, compressed air pressure vessels, for use as a mobile source of breathing air

3.4

switch over device

device that ensures that in the event of a malfunction or disconnection of the airline, the air supply, when airline is used in conjunction with self contained breathing apparatus, automatically switches over to the self contained air supply, without interruption of supplied air to the wearer

4 Description

This apparatus, with or without positive pressure, enables the wearer to be provided with breathable air, which shall be in accordance with EN 12021, which, on inhalation, flows through a lung governed demand valve operating at negative pressure (apparatus without positive pressure), or at positive pressure (apparatus with positive pressure) to a suitable facepiece, possibly via a breathing hose. A compressed air supply tube connects the wearer to a supply of compressed air. Exhaled air flows into the ambient atmosphere via an exhalation valve.

NOTE Conformance to EN 12021 can be ensured by a breathable air supply system or an additional device such as a compressed air filter system.

5 Requirements

5.1 General

Unless otherwise specified, the values stated in this European Standard are expressed as nominal values. Except for temperature limits, values which are not stated as maxima or minima shall be subject to a tolerance of $\pm 5\%$. Unless otherwise specified, the ambient temperature for testing shall be between 16 °C and 32 °C and the temperature limits shall be subject to an accuracy of ± 1 °C. Where a test clause is referenced, all subclauses of the test clause shall apply, unless otherwise stated.

5.2 Ergonomics

The requirements of this European Standard are intended to take account of the interaction between the wearer, the respiratory protective device, and where possible the working environment in which the respiratory protective device is likely to be used. The device shall satisfy 5.3, 5.9 and 5.10.

Testing shall be done accordance with 6.4.

5.3 Materials

5.3.1 All materials used in the construction shall have adequate resistance to deterioration by heat and adequate mechanical strength. Testing shall be done in accordance with 6.3, after any pre-conditioning according to 6.8, and any safety data sheet, if applicable, and declaration of the manufacturer related to materials used in the construction of the device.

5.3.2 Exposed parts, i.e. those which may be subjected to impact during use of the apparatus shall not be made of aluminium, magnesium, titanium or their alloys.

Testing shall be done in accordance with 6.3.

5.3.3 Materials that may come into direct contact with the wearer's skin or that may affect the quality of the breathed air shall not be known to be likely to cause skin irritation or any other adverse effects to health.

Testing shall be done in accordance with 6.3.

5.3.4 The finish of any part of the apparatus likely to be in contact with the wearer shall be free from sharp edges and burrs.

Testing shall be done in accordance with 6.3 and 6.4.

5.4 Water immersion

The apparatus shall continue to function satisfactorily after being submerged temporarily in water. Before immersion and after removal from the water the apparatus shall meet the requirements of 5.22.

Testing shall be done in accordance with 6.2.

NOTE The apparatus is not designed for use under water.

5.5 Cleaning and disinfecting

All materials shall be visibly unimpaired after cleaning and disinfection by the agents and procedures specified by the manufacturer.

Testing shall be done in accordance with 6.3.

5.6 Practical performance

The complete apparatus shall undergo practical performance tests under realistic conditions. These general tests serve the purpose of checking the apparatus for imperfections that can not be determined by the tests described elsewhere in this European Standard.

If during any activity, by any test subject, the test subject fails to finalise the selected activity due to the apparatus being not fit for the purpose for which it has been designed, the apparatus shall be deemed to have failed.

After completion of the activities the test subjects are asked to answer the questions in 6.6 of EN 13274-2:2001. These answers shall be used by the test house to determine if the apparatus passes or fails. The test house shall provide full details of those parts of the practical performance tests which revealed these imperfections.

NOTE This will enable other test houses to duplicate the tests and assess the results thereof.

The testing shall be done in accordance with 6.4.

5.7 Connections

5.7.1 General

Components of the apparatus shall be readily separated for cleaning, examining and testing. All demountable connections shall be readily connected and secured, where possible by hand. Any means of sealing used shall be retained in position when the joints and couplings are disconnected during normal use and maintenance.

Testing shall be done in accordance with 6.3 and 6.4.

5.7.2 Couplings

The apparatus shall be constructed so that any twisting of the hoses and tubes does not affect the fit or performance of the apparatus, or cause the hoses or tubes to become disconnected. At least one swivelling coupling shall be fitted to the compressed air supply tube adjacent to the wearer. The design of the couplings shall be such as to prevent unintentional interruption of the air supply.

Testing shall be done in accordance with 6.3 and 6.4.

5.7.3 Strength of connections to full face mask, demand valve, medium pressure connecting tube and breathing hose

Connections of the breathing hose at the full face mask and at the demand valve or between the full face mask connector and the demand valve shall withstand a force of 250 N.

Testing shall be done in accordance with 6.5.

5.7.4 Connection between apparatus and full face mask

The connection between the breathing apparatus and the full face mask may be achieved by a permanent, special or thread type connector. If a thread connector is used, either it shall conform to the requirements of one of the following standards:

- EN 148-1, for breathing apparatus without positive pressure,
- EN 148-3, for breathing apparatus with positive pressure

or if any other thread type connector is used it shall not be possible to connect it with the above mentioned threads.

The thread in accordance with EN 148-2 shall not be used with equipment covered by this European Standard.

Testing shall be done in accordance with 6.3.

5.7.5 Unacceptable connections

It shall not be possible to connect the compressed air supply tube directly to the breathing hose, medium pressure connecting tube or full face mask.

Testing shall be done in accordance with 6.3.

5.8 Compressed air line breathing apparatus used with self-contained breathing apparatus - switch over device

5.8.1 General

If a compressed air line breathing apparatus is used in conjunction with self-contained breathing apparatus meeting the requirements of prEN 137 or EN 402, a switch over device shall be provided on the airline apparatus to ensure continuous breathable air in the event of malfunction or disconnection of the air line.

During "switch over" conditions, the air supply of the self-contained breathing apparatus shall continue to meet the requirements of prEN 137 or EN 402, and the switch over shall cause no interruption of supply to the wearer. After disconnecting the compressed air supply tube, the self-contained breathing apparatus shall continue to meet the requirements of prEN 137 or EN 402.

Testing shall be done in accordance with 6.21 of prEN 137:2002 or 6.24.2 and 6.24.3 of EN 402:2003 as appropriate.

The design of the switch over device shall prevent air loss from the self-contained breathing apparatus. Testing shall be done in accordance with 6.3.

If the switch over device is connected to the compressed air supply tube, the connection shall withstand a pull force of 1 000 N.

Testing shall be done in accordance with 6.7.

If the switch over device is connected to the breathing hoses or to the medium pressure supply tube, the connection shall withstand a pull force of 250 N.

Testing shall be done in accordance with 6.5.

Couplings (if fitted) shall be self-sealing. When not connected, it shall be possible to protect all connectors from contamination. Disconnecting of the compressed air supply tube shall be possible in case of emergency and shall be operable by the user.

Testing shall be done in accordance with 6.3 and 6.4.

5.8.2 Switch over warning device

5.8.2.1 General

Once the switch over has occurred a warning signal shall be activated to give indication to the wearer of the use of breathable air from the self contained breathing apparatus.

5.8.2.2 Audible switch over warning device

If an audible warning device is incorporated, the signal may be continuous or intermittent. The peak sound pressure level shall be at least 90 dB (A) measured at the ear nearest the device and the frequency range shall be between 2 000 Hz and 4 000 Hz.

Testing shall be done in accordance with 6.3 and 6.18.

5.8.2.3 Electronic switch over warning device

Switch over warning devices which operate electrically shall conform to the Class EEx ia IIC T4 or for mining industry EEx ia I in accordance with EN 60079-0 and EN 50020, respectively. Testing shall be done in accordance with EN 60079-0 and EN 50020. Testing shall additionally be done at $-30\text{ }^{\circ}\text{C}$ and $+60\text{ }^{\circ}\text{C}$ in accordance with EN 60079-0 and EN 50020.

5.8.2.4 Pneumatic switch over warning device

Where the switch over warning devices operates pneumatically the air loss that might be caused by the warning signal shall not exceed an average of 5 l/min from response of signal to a pressure of 10 bars. The warning device shall continue to operate in a temperature range of $0\text{ }^{\circ}\text{C}$ to $10\text{ }^{\circ}\text{C}$ at a relative humidity of 90 %.

Testing shall be done in accordance with 6.1 and 6.3.

5.9 Body harness or belt

A body harness or belt shall be provided to which the medium pressure connecting tube or breathing hose, and compressed air supply tube, shall be attached. Buckles shall not slip, and the harness or belt shall not be damaged when subjected to a pull of 1 000 N.

Testing shall be done in accordance with 6.3, 6.4 and 6.7.

5.10 Performance requirements after storage

After conditioning in accordance with 6.8.1 and 6.8.2, and returning to room temperature, all performance requirements of this European Standard shall be met, except for 5.11.

Apparatus specifically designed for storage beyond the limits of storage conditioning given in 6.8.1 shall be conditioned and marked accordingly. Testing shall be done in accordance with 6.8.

5.11 Flammability

5.11.1 The requirements of 5.11.2 and 5.11.3 do not apply to the compressed air source, e.g. mobile compressed air supply systems, but do include the compressed air supply tube. Full face masks shall conform to the requirements in EN 136.

5.11.2 No exposed components of the apparatus shall continue to burn for more than 5 s after removal from the flame.

Testing shall be done in accordance with 6.9.1.

5.11.3 Wherever the manufacturer designs the apparatus to be used in applications with a high flammability risk, the exposed components shall be tested in accordance with 6.9.2. The exposed components shall not continue to burn for more than 5 s after removal from the flame and the apparatus shall be marked in accordance with Clause 7.

Testing shall be done in accordance with 6.9.2.

5.12 Resistance to pressure

The compressed air supply tube and the medium pressure connecting tube and their couplings shall be capable of withstanding a pressure of 30 bar for 15 min without damage.

Testing shall be done in accordance with 6.1 and 6.3.

5.13 Mobile high pressure air supply systems

5.13.1 General

The requirements of 5.22 shall apply simultaneously to each apparatus connected to a mobile high pressure air supply system. Where multiple wearers are supplied from one pressure reducer, the tests are conducted with the first wearer outlet attached to a breathing machine and all remaining apparatus operating at a continuous flow of 160 l/min.

The mobile high pressure air supply system shall supply breathable air in accordance with EN 12021, and shall be fitted with a pressure reducer, a high pressure gauge, medium pressure gauge, relief valve and a warning device which may be carried by the wearer.

Testing shall be done in accordance with 6.3.

5.13.2 Pressure reducer

The pressure reducer and the characteristics of the compressed air supply system incorporating the compressed air supply tube(s) shall be such that the requirements of 5.17 and 5.22 are met.

If the outlet pressure is variable, the pressure reducer shall not be adjustable without the use of special tools and the pressure gauge shall be suitably marked to indicate the pressure range.

Testing shall be done in accordance with 6.3 and 6.4.

5.13.3 Pressure reducer relief valve

A pressure reducer relief valve shall be provided. The pressure reducer relief valve shall be designed to pass an air flow of 400 l/min at a medium pressure not exceeding 30 bar. With the pressure reducer relief valve operational, the inhalation and exhalation breathing resistances shall not exceed 25 mbar.

Testing shall be done in accordance with 6.10.

5.14 Warning devices for mobile high pressure air supply systems

5.14.1 General

A warning device shall be provided which activates at minimum operating conditions specified by the manufacturer. If the equipment is intended by the manufacturer to be operated without an assistant at the air supply control, then the warning device shall be worn by the wearer.

If the equipment is intended by the manufacturer to be operated with an assistant at the air supply control, then the warning device shall warn the assistant and/or the wearer.

Testing shall be done in accordance with 6.3.

At the predetermined operating pressure of the warning device ± 5 bar the duration of the warning shall be at least 15 s for a continuous signal and at least 60 s for an intermittent signal and thereafter shall continue. The warning device shall activate when the residual air volume per user is no less than 300 litres per user at atmospheric pressure.

Testing shall be done in accordance with 6.3 and 6.17.

5.14.2 Audible warning device

If an audible warning device is incorporated, the sound pressure level shall be at least 90 dB(A) measured at the ear nearest the device in the case of the wearer, or within 1 m of the mobile high pressure air supply system in the case of an assistant. The signal may be continuous or intermittent.

At the predetermined operating pressure of the warning device ± 5 bar the duration of the warning at 90 dB(A) shall be at least 15 s for a continuous signal and at least 60 s for an intermittent signal and thereafter shall continue to sound down to 10 bar.

In the case of an audible warning device the peak sound pressure shall be at least 90 dB(A). The frequency range shall be between 2 000 and 4 000 Hz.

The warning device shall continue to operate in a temperature range of 0 °C to 10 °C at a relative humidity of 90 %.

The air loss that might be caused by the warning signal shall not exceed an average of 5 l/min from response of signal to a pressure of 10 bar. During and after response of the warning device the wearer shall be able to continue breathing without added difficulty.

5.15 Compressed air supply tube

5.15.1 Resistance to kinking

When tested, the compressed air supply tube shall maintain a uniform near-circular loop and spiral from this loop. It shall not deform during the test to an extent that decreases the flow of air through it by more than 10 %, when compared with that measured when the tube is straight and unstressed.

Testing shall be done in accordance with 6.11.

5.15.2 Resistance to collapse

The reduction in air flow when tested shall not be greater than 10 %. Testing shall be done in accordance with 6.12.

5.15.3 Strength

The compressed air supply tube, couplings and demand valve shall not separate from the couplings, belt or harness as appropriate. Testing shall be done in accordance with 6.7.

5.15.4 Flexibility

When pressurized to the maximum working pressure the compressed air supply tube shall be capable of being wound once around a drum 300 mm in diameter. Testing shall be done in accordance with 6.3.

5.15.5 Heat resistance

Compressed air supply tubes claimed to be resistant to damage from contact with hot surfaces and boiling water shall show no signs of damage or indications of failure when tested, and the air quality shall not be significantly affected.

Testing shall be done in accordance with 6.13.

5.15.6 Electrostatic properties

Compressed air supply tubes, claimed to be anti-static when measured by making connections to the couplings, shall have an electrical resistance that is greater than $10^3 \Omega$ and less than $10^8 \Omega$. Testing shall be done in accordance with EN ISO 8031.

5.15.7 Couplings

Where a hand operated connection is fitted to the outlet of the compressed air supply tube it shall incorporate a self-sealing coupling to seal the air supply when disconnected. Testing shall be done in accordance with 6.3.

5.16 Breathing hose

5.16.1 Resistance to kinking

Breathing hoses (if fitted) shall be flexible and non-kinking. Testing shall be done in accordance with 6.3 and 6.4.

5.16.2 Resistance to collapse

The air flow shall not be reduced by more than 10 % at the specified test air flow rate. There shall be no visible distortion 5 minutes after completion of the test.

Testing shall be done in accordance with 6.6.

5.17 Lung governed demand valve

5.17.1 Without positive pressure

The negative pressure for opening the lung governed demand valve shall be between 0,5 mbar and 3,5 mbar when tested using a continuous flow of 10 l/min.

A self-opening of the demand valve at negative pressures of less than 0,5 mbar shall not occur.

At a flow rate of 300 l/min the negative pressure shall not exceed 10 mbar.

These requirements shall be met over the pressure range of the air supplied to the apparatus as specified by the manufacturer.

Testing shall be done in accordance with 6.3 and 6.15.

5.17.2 With positive pressure

The apparatus shall conform to the requirements of 5.22. Testing shall be done in accordance with 6.15.

5.17.3 Supplementary air supply

Apparatus without positive pressure shall be provided with a manually operated means of providing a supply of air at a flow rate of at least 60 l/min at the manufacturer's minimum stated compressed air supply conditions. Testing shall be done in accordance with 6.3, 6.4 and 6.15.3.

NOTE Apparatus with positive pressure may also be provided with such a device.

5.17.4 Couplings

Where a hand operated coupling is fitted between the demand valve and a connector at the waist belt or body harness it shall incorporate a self-sealing device to prevent loss of air from the compressed air supply tube. Testing shall be done in accordance with 6.3 and 6.4.

5.18 Adjustable parts

All parts requiring manipulation by the wearer shall be readily accessible and easily distinguishable from one another by touch. All adjustable parts and controls shall be constructed so that their adjustment is not liable to accidental alteration during use. Parts that are not intended for adjustment by a wearer shall require the use of tools for their adjustment.

Testing shall be done in accordance with 6.3 and 6.4.

5.19 Full face masks

Full face masks shall conform to EN 136:1998, Class 2 or Class 3. Testing shall be done in accordance with 6.3.

5.20 Inward leakage

Where the facepiece is not fitted with a connection in accordance with EN 148-1, the mean inward leakage of the complete device, including the facepiece, shall not exceed 0,05 %.

NOTE When a facepiece fitted with a connection in accordance with EN 148-1 has been used, the inward leakage test described in EN 136 will have been performed.

Testing shall be done in accordance with 6.14.

Testing shall be done in accordance with EN 13274-1 with respect to:

- number of samples;
- device preparation;
- selection and number of test subjects;
- any prior conditioning or testing;
- test method (1, 2a, 2b);
- any deviations from the method;
- use of supplementary fans if applicable;
- characteristics to be assessed subjectively;
- pass/fail criteria.

5.21 Inhalation and exhalation valves

All complete apparatus not fitted with a connection in accordance with EN 148-1 may be provided with an inhalation valve and shall have one or more exhalation valves. Valve assemblies shall be such that they can be readily maintained and correctly replaced. It shall not be possible to fit an inhalation assembly in the expiratory circuit.

Testing shall be done in accordance with 6.3.

5.22 Breathing resistance

5.22.1 General

The requirements of 5.22.2 and 5.22.3 apply both before and after the water immersion in accordance with 5.4 and at the extremes of the pressure range of the air supply to the apparatus as specified by the manufacturer.

5.22.2 Inhalation resistance

5.22.2.1 Apparatus without positive pressure

At a sinusoidal flow of 25 x 2 l/min, the inhalation resistance of an apparatus without facepiece shall not exceed 4,5 mbar. The negative pressure shall not exceed 7 mbar when fitted with a facepiece.

Testing shall be done in accordance with 6.15.

5.22.2.2 Apparatus with positive pressure

The apparatus shall be designed so that at a sinusoidal flow of 40 x 2,5 l/min, the positive pressure is maintained in the cavity of the mask adjacent to the face seal and shall not exceed 5 mbar. If the apparatus is equipped with a thread connector in accordance with EN 148-3, then the arrangement in accordance with Annex A shall be used.

Testing shall be done in accordance with 6.15.

5.22.3 Exhalation resistance

5.22.3.1 Apparatus without positive pressure

The exhalation resistance shall not exceed 3 mbar, when tested using a breathing machine at a flow rate of 50 l/min (25 cycles/min and 2 l/stroke). Testing shall be done in accordance with 6.15.

5.22.3.2 Apparatus with positive pressure

The exhalation resistance shall not exceed 6 mbar at a continuous flow of 10 l/min, 7 mbar at a sinusoidal flow of 25 x 2 l/min, and 10 mbar at a sinusoidal flow of 40 x 2,5 l/min.

Testing shall be done in accordance with 6.15.

5.23 Carbon dioxide content of inhalation air

Where apparatus uses an equipment connector not conforming to EN 148-1, the complete apparatus including the face mask shall be tested, and the carbon dioxide content of the inhaled air shall be not greater than an average of 1 % by volume.

NOTE When a facepiece fitted with a connection in accordance with EN 148-1 has been used, the inward leakage test described in EN 136 will have been performed.

Testing shall be done in accordance with 6.16.

5.24 Leaktightness

With the maximum designed working pressure applied to the apparatus, the compressed air supply tube, medium pressure connecting tube, couplings, demand valve and breathing hose (if fitted), shall be tested for

leaktightness by immersion in water for 1 minute. The demand valve shall be activated, and the apparatus sealed at its facepiece connection.

The test shall be applied immediately before and after the tests in 6.7 and shall subsequently be applied after all laboratory testing is completed with the exception of that for flammability. No bubbles shall be observed escaping from the apparatus.

Testing shall be done in accordance with 6.3 and 6.7.

6 Testing

6.1 General

Table 1 details the test and requirement clause numbers.

Table 1 — Testing schedule

Test clause	Title	Storage conditioning to 6.8	Requirement clause
6.2	Water immersion	Yes	5.4
6.3	Visual inspection	Yes	5.3, 5.5, 5.7, 5.8, 5.9, 5.12, 5.13, 5.14, 5.15, 5.16, 5.17, 5.18, 5.24
6.4	Practical performance	Yes	5.6, 5.7, 5.9, 5.10, 5.13, 5.16, 5.17, 5.18
6.5	Strength of connections to facepiece, demand valve, medium pressure connecting tube and breathing hose	Yes	5.7, 5.8
6.6	Resistance to collapse of breathing hose	Yes	5.16
6.7	Strength of compressed air supply tube, body harness and couplings	Yes	5.8, 5.15, 5.24
6.8	Storage conditioning	Yes	5.10
6.9	Flammability	No	5.11, 5.15
6.10	Pressure reducer relief valve	Yes	5.13
6.11	Resistance to kinking of compressed air supply tube	Yes	5.15
6.12	Resistance to collapse of compressed air supply tube	Yes	5.15
6.13	Heat resistance of compressed air supply tube	Yes	5.15
6.14	Inward leakage	Yes	5.21
6.15	Tests for lung-governed demand valve	Yes	5.17, 5.22
6.16	Carbon dioxide content of inhalation air	Yes	5.23
6.17	Audible warning device	Yes	5.14
6.18	Switch over device	Yes	5.8.1

Before performing tests involving human subjects, account shall be taken of any national regulations concerning the medical history, examination or supervision of the test subjects. If no special measuring devices or measuring methods are specified, commonly used methods and devices should be applied.

The flammability test in 6.9 shall be carried out on two unconditioned samples, which are not then used for other tests.

The conditioning procedure described in 6.8 shall be completed on two test samples prior to the remaining tests being carried out. In all tests, both test samples need to meet the requirements.

The leaktightness test shall be carried out on the conditioned samples after all other tests except the practical performance test have been completed. The practical performance test shall be carried out using the two conditioned samples after all other tests, with the exception of flammability, have been completed.

Positive pressure apparatus shall be tested as complete apparatus including the facepiece, as supplied by the manufacturer.

6.2 Water immersion

The facepiece of the complete apparatus is fitted to a dummy head, which in turn is connected to a breathing machine by a flexible hose.

The test is conducted with the breathing machine adjusted to 25 cycles/min and 2 l/stroke. The complete apparatus as worn is immersed in water to a depth of between 0,25 m and 0,80 m for a period of not less than 3 and not more than 5 full breathing cycles. A series of tests is carried out with the apparatus immersed and with the dummy head in two orientations, which represent respectively the maximum and minimum differential pressures between the lung governed demand valve and the exhalation valve.

The apparatus and dummy head are removed from the water after each test at each orientation.

Measure the breathing resistance at the appropriate pressure sample points using a precision gauge. The breathing resistance is recorded prior to and immediately after each immersion. The presence of water in the facepiece after the test does not constitute a reason for failure and any water present may be removed prior to measurement of breathing resistance.

6.3 Visual inspection

A visual inspection shall be made by the test house prior to laboratory or practical performance tests. This may entail a certain amount of dismantling in accordance with the manufacturer's instructions for maintenance. The visual inspection shall include the assessment of the device marking and information supplied by the manufacturer and any safety data sheets (if applicable) or declarations relevant to the materials used in its construction.

6.4 Practical performance

6.4.1 General

Practical performance tests shall be carried out in accordance with EN 13274-2, using two sets of apparatus and four test subjects. Apparatus which has satisfied the laboratory tests shall be used. The test plan shall be as shown below.

Test subjects 1 and 2 shall use apparatus 1. Test subjects 3 and 4 shall use apparatus 2.

6.4.2 Preparation of apparatus to be tested

Before each test check the apparatus for leaktightness. Ensure that air supplies from compressed air systems or from compressed air cylinders are within the specified pressures. The length of the compressed air supply

tube shall be the maximum specified by the manufacturer, including the maximum number of permitted connections.

6.4.3 Test conditions

All tests shall be carried out at ambient conditions which shall be recorded.

6.4.4 Work simulation test

The following activities shall be done in simulation of the practical use of the apparatus. The test shall be completed within a total working time of 30 min. The test shall be continuous without removal of the apparatus.

The sequence and durations of activities are at the discretion of the test house. The individual activities shall be arranged so that sufficient time is left for the measurements prescribed.

- activity number 15 of EN 13274-2:2001;
- activity number 4 of EN 13274-2:2001;
- activity number 3 of EN 13274-2:2001;
- activity number 10 of EN 13274-2: 2001;
- activity number 12 of EN 13274-2:2001;
- activity number 16 of EN 13274-2:2001.

If the exercises have been completed within less than 30 min the remaining time is used by the subject to walk at 6 km/h.

6.4.5 Information to be recorded

The assessments in accordance with EN 13274-2 shall be recorded. During the tests the device shall be subjectively assessed by each wearer, and after the test, the answers to the questions (as applicable) in 6.6 of EN 13274-2:2001 shall be recorded individually and in private. If during any activity, by any test subject the test subject fails to finalise the selected activity due to the apparatus being not fit for the purpose for which it has been designed, the apparatus shall be deemed to have failed.

6.4.6 Practical performance tests at low temperature

6.4.6.1 Temperature of cold chamber

Temperature of cold chamber for these tests shall be between -6 °C and -9 °C according to 6.5 of EN 13274-2:2001.

6.4.6.2 Test with pre-cooled apparatus

Two apparatus are cleaned according to the information supplied by the manufacturer and any excess liquid removed by shaking. The apparatus are then made ready for use and pre-cooled for not less than 2 h but no more than 3 h in the cold chamber.

Two warmly clothed subjects each don an apparatus in the cold chamber and carry out the test in accordance with activity 17 in EN 13274-2:2001 items a, b, and c.

6.4.6.3 Test with apparatus at ambient temperature

Two apparatus are prepared ready for use and conditioned at ambient temperature. Two test subjects carry out the test in accordance with activity 17 in EN 13274-2:2001 items a, b and c.

6.5 Strength of connections to facepiece, demand valve, medium pressure connecting tube and breathing hose

For each of the connections of components between the waist belt/harness to the facepiece, apply an axial force of 250 N for (10 ± 1) s. The connections shall withstand the test with no visible signs of damage. See Figure 1.

6.6 Resistance to collapse of breathing hose

6.6.1 Principle

A specified air flow is passed through the breathing hose which is subjected to a specified load. The change in air flow is measured.

6.6.2 Apparatus

Two metal plates 100 mm square, or circular with a diameter of 100 mm, and thickness at least 10 mm. One plate is fixed and the other is capable of moving at right angles to the plane of the plates. The moving plate is capable of being loaded to ensure a total force of 50 N can be applied between the plates. See Figure 5.

6.6.3 Procedure

Place the breathing hose centrally between the two plates and pass air at a rate of 120 l/min through the hose. Apply the test force of 50 N (which includes that due to the moveable plate itself) to the hose and measure the air flow again. Calculate the reduction in flow.

6.7 Strength of compressed air supply tube, body harness and couplings

The belt or body harness with couplings and demand valve (if present) is secured to a dummy torso in an upright position. A steady pull of 1 000 N is applied to the compressed air supply tube for 5 min. Figure 2 shows suitable test details.

6.8 Storage conditioning

6.8.1 Conditioning

In order to ensure that there is no thermal shock during the conditioning of the specimens, the temperature gradient shall be less than 2 °C/min between phases at different temperatures, or between the beginning and the end of a thermal cycle.

The apparatus shall be conditioned according to the following order:

- a) 4 h to 16 h at (60 ± 3) °C and at least 95 % relative humidity or the manufacturer's stated maximum temperature and humidity, whichever is the higher.
- b) 4 h to 16 h at (-30 ± 3) °C or the manufacturer's stated minimum, whichever is the lower.

The apparatus shall then be allowed to return to ambient conditions (at least 4 h) before further testing.

6.8.2 Laboratory test after conditioning

After conditioning in accordance with 6.8.1, the apparatus shall be operated for at least 30 min. using a breathing machine operating at 25 cycles/min, 2 l/stroke.

6.9 Flammability

6.9.1 Carry out flammability tests in accordance with EN 13274-4, using Method 3.

6.9.2 Carry out flammability tests in accordance with EN 13274-4, using Method 2.

6.10 Pressure relief valve

Connect the apparatus, including the full face mask, to a breathing machine and to a "Sheffield" dummy head. Adjust the breathing machine to operate at 25 cycles/min and 2 l/stroke.

With the breathing machine not operating, connect a flow measuring device to the outlet of the pressure reducer relief valve and supply air to the medium pressure side of the pressure reducer. Increase the air supply pressure slowly until an air flow of 400 l/min passes through the pressure relief valve. When this condition has been established switch the breathing machine on and measure the breathing resistance at the appropriate pressure sample point.

6.11 Resistance to kinking of compressed air supply tube

Apply the minimum supply pressure specified by the manufacturer to the supply end of the tube. Connect a means of measuring air flow to the tube. Figures 3 and 4 show the principle of the test and an outline of an apparatus that has proved satisfactory for this test.

Place a length of the tube on a horizontal surface and shape into a one loop coil of (300 ± 10) mm diameter. Pull the ends of the loop tangentially to the loop and in the plane of the loop until the tube takes the form of a straight line. It may be convenient to clamp one end of the loop and pull the other.

Observe the manner in which the tube unfolds and measure the air flow as it is unfolded.

6.12 Resistance to collapse of compressed air supply tube

6.12.1 Principle

A specified air flow is passed through the compressed air supply tube, a specified load is applied to the tube and the change in air flow measured.

6.12.2 Apparatus

- a) Two metal plates 100 mm square, or circular with a diameter of 100 mm and a thickness of at least 10 mm. One plate is fixed and the other capable of moving at right angles to the plane of the plates. The moving plate is capable of being loaded to provide a total force of 1 000 N applied between the plates (see Figure 5).
- b) Flow meter.

6.12.3 Procedure

Place the compressed air supply tube centrally between the two plates and pass an air flow of 120 l/min, through the tube. Record the flow.

Apply a force of 1 000 N (which includes that due to the moveable plate itself) to the moveable plate and measure the air flow again.

6.13 Heat resistance of compressed air supply tube

With the compressed air supply tube at the manufacturer's maximum stated supply pressure apparatus is tested on a breathing machine at 25 cycles/min and 2 l/stroke. Approximately 100 mm of the compressed air supply tube is placed in contact with a hot plate maintained at $(130 \pm 15) ^\circ\text{C}$ and a further part immersed in boiling water.

After 15 min remove the compressed air supply tube from the hot plate and the boiling water, examine for signs of damage and check that the quality of the air passing through the hose has not been significantly affected.

6.14 Inward leakage

Measure the inward leakage of the complete device, including the full face mask, in accordance with EN 13274-1.

Two specimens shall be used for the tests, one in the as received condition and one conditioned in accordance with 6.8.1. Preparation of the device shall be as described in EN 13274-1:2001, 8.1 and 8.4. Ten, clean shaven, test subjects shall be used, selected as described in EN 13274-1:2001, 9.1.

Test methods 1 (sulfur hexafluoride) or 2A (sodium chloride, pulsed sampling) are equally acceptable.

6.15 Tests for lung-governed demand valve

6.15.1 Without positive pressure

This test uses as a basis method 1 of EN 13274-3.

For devices employing EN 148-1 threads, connect the equipment to the test device shown in Figure 6 and replace the dummy head in the apparatus described in method 1 of EN 13274-3 by the test device.

Follow the procedure for the measurement of inhalation resistance given in method 1 of EN 13274-3, while operating the equipment (e.g. air line, demand valve) at the extremes of supply pressure as specified in the manufacturer's instructions, and applying the appropriate constant flow to the test device or dummy head as appropriate.

Record the pressure at which the lung-governed demand valve opens and the pressure at a flow of 300 l/min.

6.15.2 With positive pressure

This test uses as a basis method 2 of EN 13274-3.

Operate the equipment at the extremes of pressure as specified in the manufacturer's instructions, and test in accordance with method 2 of EN 13274-3, except that the manometer is connected to a pressure probe in the cavity of the face mask adjacent to the face seal, and the output of the manometer is connected to the recording device.

6.15.3 Supplementary air supply

Connect the equipment as in 6.15.1 and operate at the minimum stated compressed air supply conditions. Whilst operating the supplementary supply, withdraw a steady air flow of 60 l/min from the test device or dummy head as appropriate. Record whether the pressure is positive or negative. If the pressure is negative report fail.

6.16 Determination of carbon dioxide content of the inhalation air

Measure the carbon dioxide content of the inhalation air in accordance with EN 13274-6.

6.17 Testing of audible warning device

The performance of the warning device is measured during a breathing machine test at 25 cycles/min x 2 l/stroke. To test the warning device at temperatures between 0 °C and 10 °C air shall be passed through the apparatus in a climatic test chamber using a breathing machine (adjusted to 25 cycles/min x 2 l/stroke).

During the test the environment of the apparatus shall have a temperature of (3 ± 1) °C and a relative humidity of > 90 %. Every 5 min, water shall be sprayed on for 3 s using a spray gun directed at the warning device from a distance of 200 mm.

NOTE Information on the spray gun can be obtained from the secretariat of CEN/TC 79.

6.18 Switch over device

The switch over (and warning) device shall be tested whilst the airline supply is connected and the main cylinder valve of the self-contained breathing apparatus is open. The airline supply will be closed whilst maintaining the connection to the SCBA. The performance of the switch over (and warning) device is measured during a breathing machine test at 25 cycles/min x 2 l/stroke.

Once the device has actuated and the warning device operated the test will continue observing three cycles of warning after which the airline supply will be reopened and the warning observed.

To test the switch over device at temperatures between 0 °C and 10 °C air shall be passed through the apparatus in a climatic test chamber using a breathing machine (adjusted to 25 cycles/min x 2 l/stroke).

During the test the environment of the apparatus shall have a temperature of (3 ± 1) °C and a relative humidity of > 90 %. Every 5 min, water shall be sprayed on for 3 s using a spray gun directed at the switch over device from a distance of 200 mm.

NOTE Information on the spray gun can be obtained from the secretariat of CEN/TC 79.

7 Marking

7.1 All units of the same model shall be provided with a type identifying marking. The marking shall be clearly visible and as durable as possible. Components which can be changed by the user and sub-assemblies with considerable bearing on safety shall be readily identifiable.

For parts that cannot reasonably be marked, the relevant information shall be included in the information to be supplied by the manufacturer.

NOTE For marking of components, see Annex B.

7.2 Where the reliable performance of piece parts may be affected by ageing, the date (at least the year) of manufacture shall be marked. For parts which cannot be marked the relevant information shall be included in the operating instructions.

7.3 The apparatus, excluding the compressed air supply tube, shall be marked with:

- the number of this European Standard;
- the storage temperatures the apparatus is designed to withstand, or the appropriate pictogram from EN 132, if different from this European Standard;

- the year of manufacture (4 digits);
- the manufacturer's name, trade mark or other means of identification;
- the phrase "see information supplied by the manufacturer" or the appropriate pictogram;
- if appropriate, the marking 'F' to show that the apparatus meets the additional requirements of 5.11.3.

7.4 The compressed air supply tube shall be marked at least with:

- the manufacturer's part number or the manufacturer's type identification;
- the year of manufacture;
- the manufacturer's trade name, trademark or other means of identification;
- if appropriate the marking 'H' for 'heat resistant', to show that the tube meets the requirements of 5.15.5;
- if appropriate the marking 'S' for 'anti-static', to show that the tube meets the requirements of 5.15.6;
- if appropriate, the marking 'F' to show that the tube meets the additional requirements of 5.11.3.

8 Information supplied by the manufacturer

8.1 Information supplied by the manufacturer for use in the official language(s) of the country of destination shall accompany every apparatus on delivery enabling trained and qualified persons to use it. This information shall comprise the range of application and instructions necessary for correct fitting, care, maintenance and storage.

NOTE It is recommended that maintenance instructions be provided separately to the information supplied by the manufacturer.

8.2 Other information shall comprise:

- correct selection and fitting of the facepiece;
- whether or not designed to withstand storage in low or high temperature;
- the maximum length of compressed air supply tube, and the maximum number of compressed air supply tubes that may be joined together to give that length;
- the pressure range of the air supply to the apparatus;
- the maximum working pressure of the compressed air supply tube;
- where appropriate a warning that adequate protection may not be provided by the apparatus in certain highly toxic atmospheres;
- a warning that at very high work rates the pressure in the full face mask may become negative at peak inhalation flow;
- a warning concerning the need to ensure breathable air in accordance with EN 12021;
- a warning that the moisture content of the breathable air should be controlled within the limits in accordance with EN 12021, to avoid the air freezing the apparatus;

- a warning against the use of oxygen or oxygen enriched air;
- a recommendation that the user checks that the capacity of the air supply system is sufficient for every user connected to it, in accordance with the manufacturer's instructions;
- the statement: 'Where appropriate, the marking 'F' on the apparatus and the CAST indicates that both can be used in situations where flammability may be a risk;
- where appropriate, a statement that the compressed air supply tube is heat-resistant (H) and/or anti-static (S);
- information on cleaning and disinfecting procedures;
- a warning with devices connected to a mobile high pressure air supply system as to whether or not the manufacturer intends the device to be operated with an assistant, together with appropriate instructions concerning the warning device;
- where appropriate, instructions for a switch-over device;
- information on spare parts (if appropriate);
- a warning against other possible connections to couplings connected to pipe systems that supply other gases than breathable air; risk assessment by the user against possible perilous connections possible at the workplace, e.g. Nitrox;
- any other information the supplier may care to provide;
- the maximum number of users that can be connected simultaneously to a mobile high pressure compressed air system.

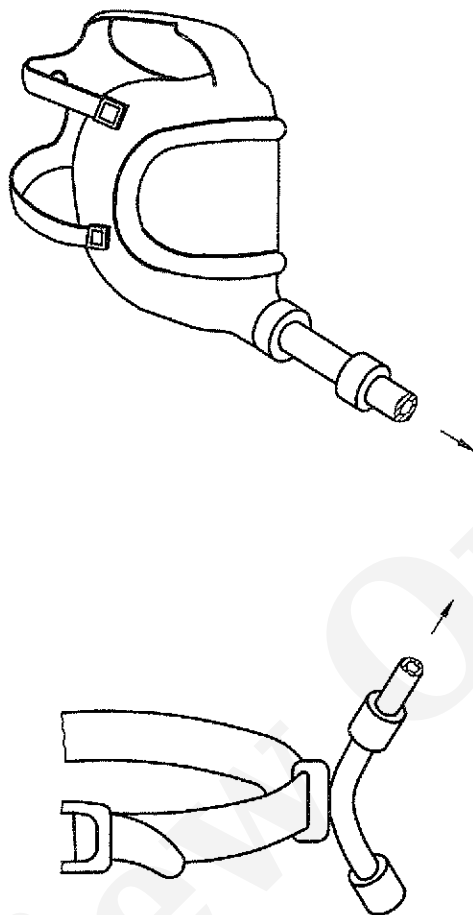


Figure 1 — Measurement of strength of breathing hose connections


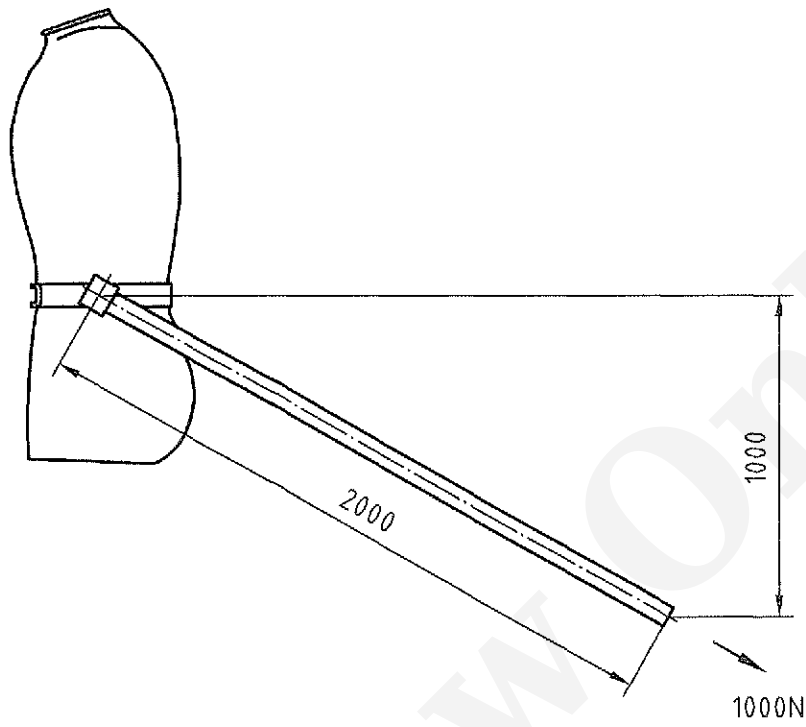



Figure 2 — Arrangement for testing strength of body harness or belt, compressed air supply tube and couplings

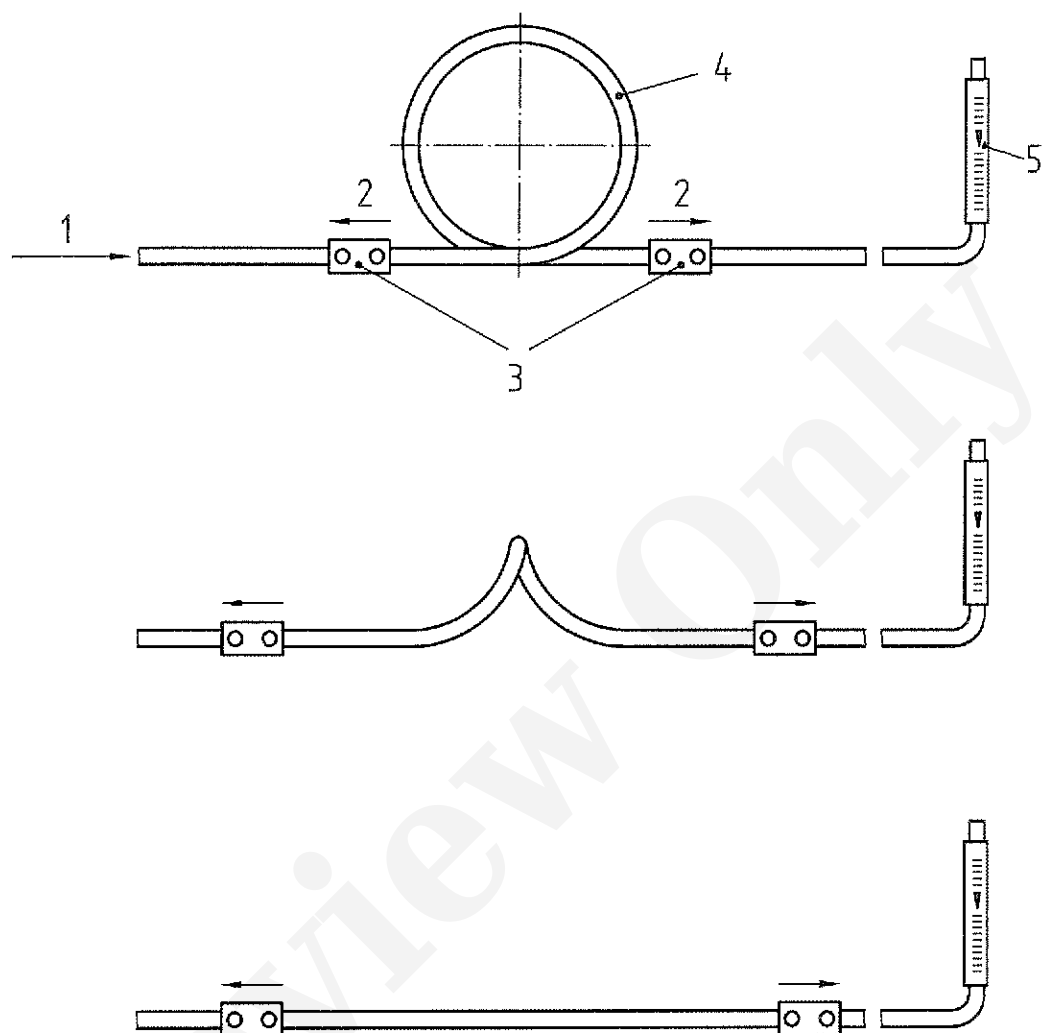

Key

- 1 Air supply
- 2 Direction of travel
- 3 Clamps
- 4 Tube
- 5 Flow meter

Figure 3 — Arrangement for testing kinking of compressed air supply tube

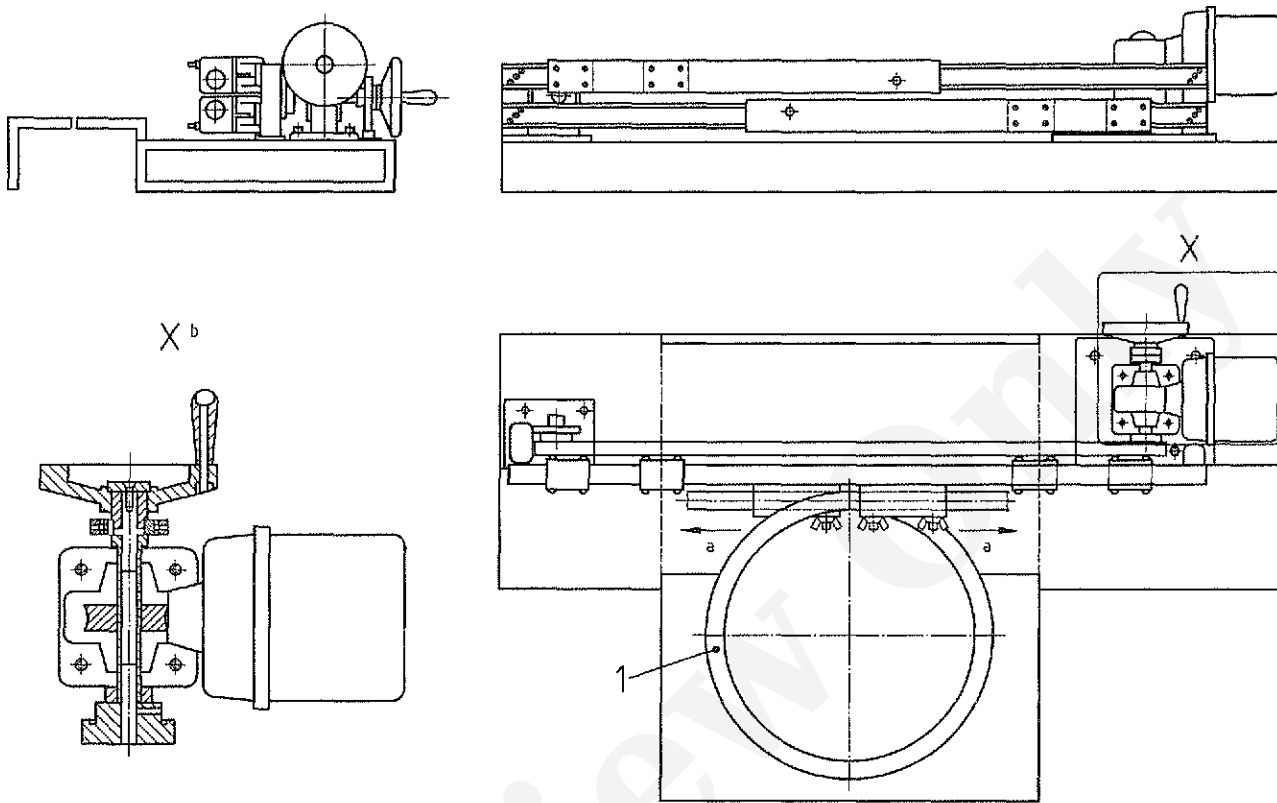

- Key**
1 Tube
a Direction of travel
b Section detail X

Figure 4 — Arrangement for testing kinking of compressed air supply tube

Dimensions in millimetres


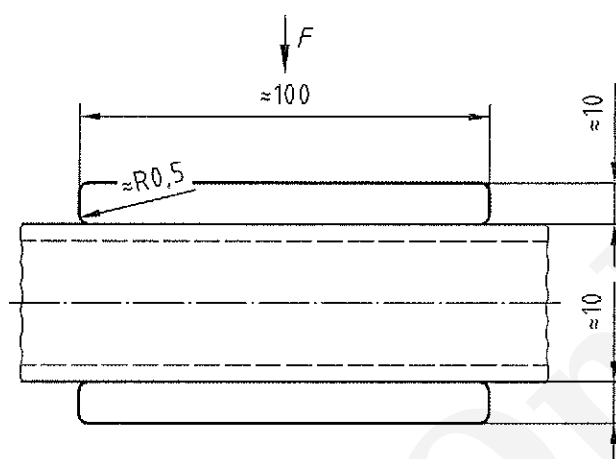


Figure 5 — Arrangement for testing collapse of compressed air supply tube

Dimensions in millimetres

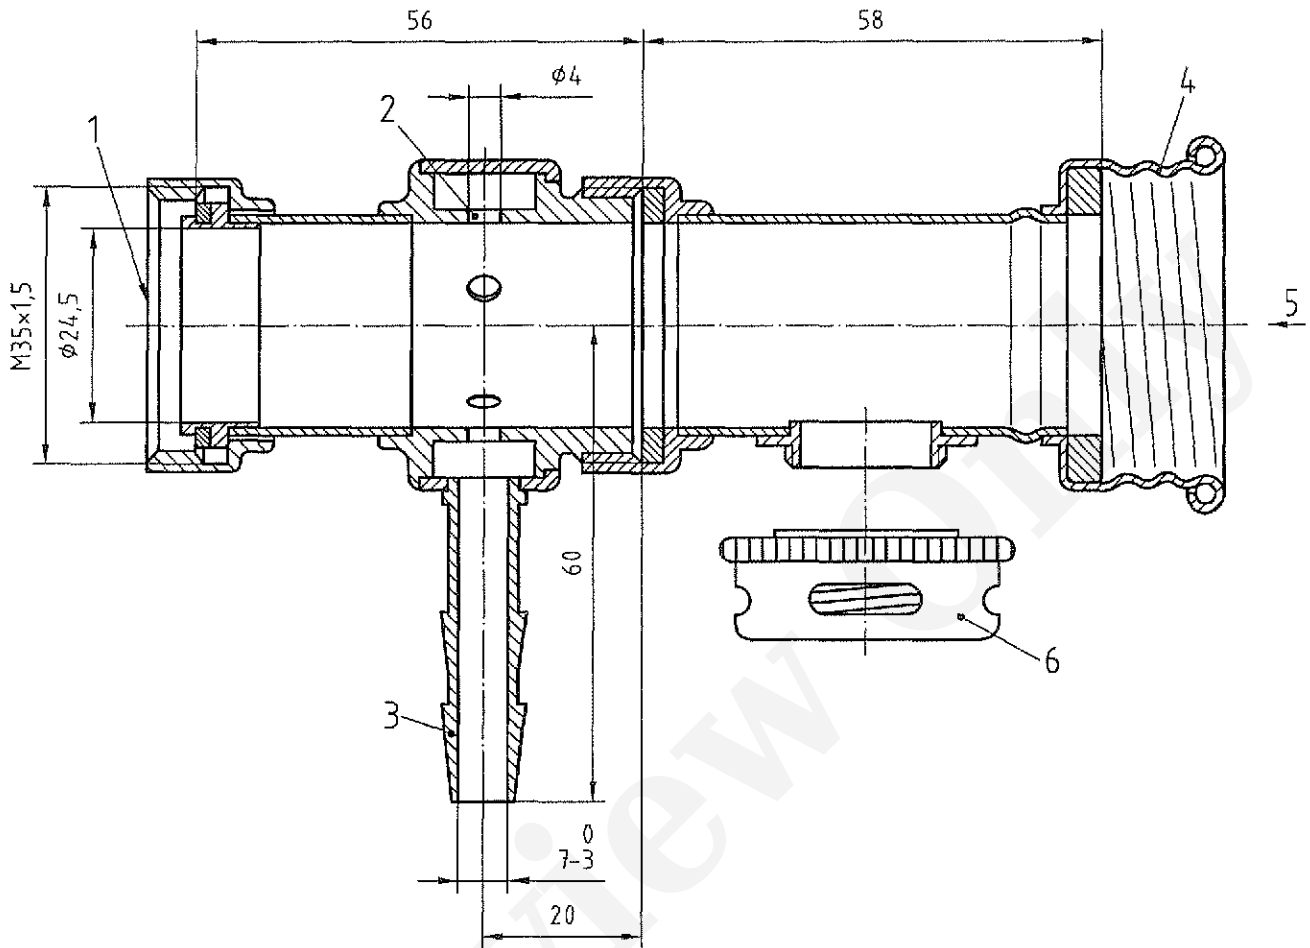

Key

- 1 Connection for breathing machine
- 2 Five holes
- 3 Measurement point for breathing resistance
- 4 Connector (EN 148-1)
- 5 Connection for apparatus
- 6 Exhalation valve having a resistance of 3 mbar at 25 x 2 l/min sinusoidal flow or max 160 l continuous flow

Figure 6 — Test device used in the measurement of breathing resistance

Annex A (normative)

Static and dynamic pressure for apparatus with thread connector in accordance with EN 148-3

A.1 General

This annex is provided for apparatus, with a thread connector in accordance with EN 148-3, which may be inadvertently connected to an existing facepiece with an EN 148-3 connector. In the event of inadvertently coupling such to apparatus in accordance with this European Standard these additional clauses should ensure safe compatibility. This annex does not imply that apparatus and facepieces which have not been tested and approved as complete apparatus may be used.

A.2 Static pressure

The lung governed demand valve of apparatus designed with a connector according to EN 148-3 shall maintain a static pressure of $\leq 3,9$ mbar in the positive pressure mode.

For testing the lung governed demand valve shall be fitted with a cap that can be ventilated and has a port for measuring the pressure using a precision manometer. An air flow of 5 l/min shall be released for a short time. The static pressure shall be measured after the ventilation is shut off.

A.3 Dynamic pressure

A positive pressure shall be maintained when the apparatus is tested with a breathing machine (adjusted to 40 cycles/min, 2,5 l/stroke) at the minimum supply pressure specified by the manufacturer. See Figure A.1.


During the inhalation phase the positive pressure shall not exceed 4,2 mbar.

A.4 Exhalation valve

If the lung governed demand valve has an exhalation valve the opening pressure of this exhalation valve shall be at least 4,2 mbar measured at a continuous flow of 10 l/min.

A.5 Testing

A test rig as shown in Figure A.1 shall be used. A breathing machine delivering sinusoidal flow shall be used. The pressure shall be measured at the port near the orifice. The orifice module shall be designed to have a resistance to air flow of 3,5 mbar at a continuous flow of 300 l/min.

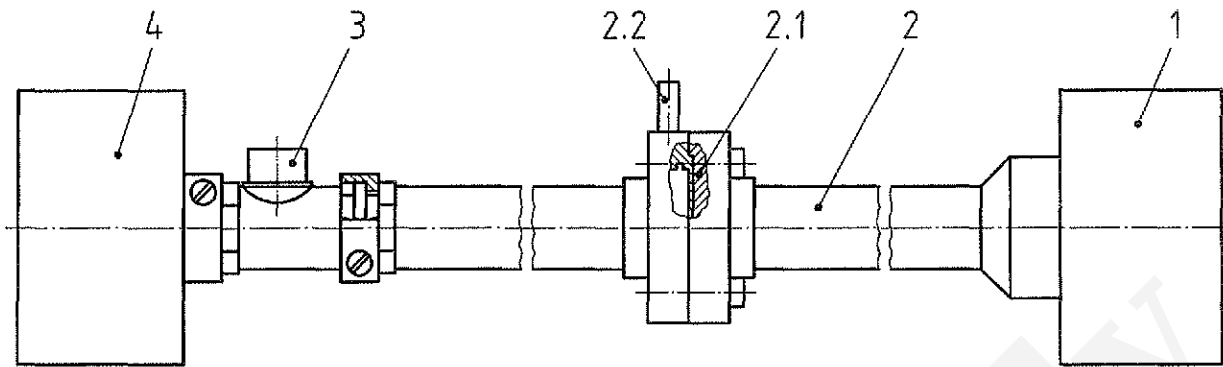

Key

- 1 M 45 x 3 threaded device
- 2 Orifice module
- 2.1 Orifice
- 2.2 Measuring port
- 3 Exhalation valve
- 4 Breathing machine connector

Figure A.1 — Scheme of test rig for dynamic pressure

Annex B (informative)

Marking

It is recommended that consideration be given to marking the following components and sub-assemblies - if applicable - to be identifiable.

Table B.1 — Marking

Components/subassemblies	Part-marking	Date of manufacture	Remarks
Pressure reducer	+	+	
Demand valve	+	+	
Breathing hose (if fitted)	+	+	
Inhalation valve disc	+	+	1
Exhalation valve disc	+	+	1
Full face mask			according to EN 136
Body harness/Belt	-	-	1
Medium pressure connecting tube (if fitted)	-	+	
Compressed air supply tube	+	+	
Compressed air container			according to the relevant standards
Compressed air container valve			according to the relevant standards
<p>Key</p> <ul style="list-style-type: none"> + The marking is necessary. - The marking is not necessary. 1 For parts which cannot reasonably be marked the relevant information shall be included in the information to be supplied by the manufacturer. <p>The components of a sub-assembly need not be marked when the sub-assembly is identifiable. Those components not offered as spare parts by the manufacturer need not be marked but the relevant information should be given in the information to be supplied by the manufacturer.</p>			

Annex ZA (informative)

Relationship between this European Standard and the Essential Requirements of EU Directive 89/686/EEC (PPE)

This European Standard has been prepared under a mandate given to CEN/CENELEC by the European Commission and the European Free Trade Association to provide a means of conforming to Essential Requirements of the New Approach Directive 89/686/EEC on the Approximation of the laws of the Member States relating to Personal Protective Equipment.

Once this standard is cited in the Official Journal of the European Communities under that Directive and has been implemented as a national standard in at least one Member State, compliance with the clauses of this standard given in table ZA confers, within the limits of the scope of this standard, a presumption of conformity with the corresponding Essential Requirements of that Directive and associated EFTA regulations.

Table ZA — Correspondence between this European Standard and Directive 89/686/EEC

Clause(s)/ sub-clause(s) of this EN	Essential Requirements (ERs) of Directive 89/686/EEC	Qualifying remarks/ Notes
5.2	1.1.1 Ergonomics	
5.2	1.1.2.1 Highest level of protection possible	
5.2	1.2.1.3 Maximum permissible user impediment	
5.2	1.3.1 Adaptation of PPE to user morphology	
5.2	2.3 PPE for the face, eyes and respiratory tracts	
5.3.2	2.6 PPE for use in explosive atmospheres	
5.3.3	1.2.1.1 Suitable constituent materials	
5.3.4	1.2.1.2 Satisfactory surface condition of all PPE parts in contact with the user	
5.4	1.2.1 Absence of risks and other inherent nuisance factors	
5.6	1.1.1 Ergonomics	
5.6	1.1.2.1 Highest level of protection possible	
5.6	1.2.1.3 Maximum permissible user impediment	
5.6	1.3.1 Adaptation of PPE to user morphology	
5.7.1	2.9 PPE incorporating components which can be adjusted or removed by the user	
5.7.2	1.2.1 Absence of risks and other inherent nuisance factors	
5.7.3	1.3.2 Lightness and design strength	
5.7.4	2.10 PPE for connection to another, external complementary device	
5.7.5	1.2.1 Absence of risks and other inherent nuisance factors	
5.8.1	1.2.1 Absence of risks and other inherent nuisance factors	
5.8.1	1.3.2 Lightness and design strength	
5.8.2	2.8 PPE for use in very dangerous situations	
5.8.2.3	1.2.1 Absence of risks and other inherent nuisance factors	

5.8.2.3	2.6	PPE for use in explosive atmospheres	
5.8.2.4	1.2.1	Absence of risks and other inherent nuisance factors	
5.9	1.3.2	Lightness and design strength	
5.9	2.1	PPE incorporating adjustment systems	
5.10	1.3.2	Lightness and design strength	
5.11.2	1.2.1	Absence of risks and other inherent nuisance factors	
5.11.3	1.2.1	Absence of risks and other inherent nuisance factors	
5.12	1.3.2	Lightness and design strength	
5.14.2	2.8	PPE for use in very dangerous situations	
5.15.1	1.2.1	Absence of risks and other inherent nuisance factors	
5.15.2	1.2.1	Absence of risks and other inherent nuisance factors	
5.15.3	1.3.2	Lightness and design strength	
5.15.4	1.3.2	Lightness and design strength	
5.15.5	1.2.1	Absence of risks and other inherent nuisance factors	
5.15.6	2.6	PPE for use in explosive atmospheres	
5.15.7	1.2.1	Absence of risks and other inherent nuisance factors	
5.16	1.2.1	Absence of risks and other inherent nuisance factors	
5.17.1	3.10.1	Respiratory protection	
5.17.2	3.10.1	Respiratory protection	
5.17.3	3.10.1	Respiratory protection	
5.17.4	1.2.1	Absence of risks and other inherent nuisance factors	
5.18	1.2.1	Absence of risks and other inherent nuisance factors	
5.18	2.1	PPE incorporating adjustment systems	
5.19	3.10.1	Respiratory protection	
5.20	3.10.1	Respiratory protection	
5.21	1.2.1	Absence of risks and other inherent nuisance factors	
5.21	2.10	PPE for connection to another, external complementary device	
5.22	3.10.1	Respiratory protection	
5.23	3.10.1	Respiratory protection	
5.24	3.10.1	Respiratory protection	
7	2.12	PPE bearing identification marks related to health and safety	
7	3.10.1	Respiratory protection	
8	1.4.	Information supplied by the manufacturer	
8	2.8.	PPE for use in very dangerous situations	
8	2.12	PPE bearing identification marks related to health and safety	

WARNING: Other requirements and other EU Directives may be applicable to the product(s) falling within the scope of this standard.

Acknowledgements

Members of Technical Committee on Personal Safety - Protective Clothing and Equipment for Occupational Use

Mr Abdul Kahar Husain (Chairman)	Department of Occupational Safety and Health Malaysia
Ms Lee Hooi Lan (Secretary)	SIRIM Berhad
Mr Daryl Low	3M Malaysia Sdn Bhd
Mr Chuang Kuang Hong	Construction Industry Development Board Malaysia
Mr Mohamed Rafiq Sulaiman	Department of Chemistry, Malaysia
Dr Yusof Abdullah	Malaysian Nuclear Agency
Mr Busari Jabar/	PETRONAS Carigali Sdn Bhd
Ms Norhazlina Mydin	
Mr Danny Wan Chee Kin	ProGuard Technologies (M) Sdn Bhd
Mr Hamdan Kamaludin	Projek Lebuhraya Utara-Selatan Berhad
Ms Haryatti Mohd Arif	Science and Technology Research Institute for Defence
Mr Abdul Azis Arshat/	SIRIM QAS International Sdn Bhd (Product Certification & Inspection Department)
Mr Muhammad Tashriff Shah Helmy Syamza	SIRIM QAS International Sdn Bhd (Testing Services Department)
Mr Wan Mohd Rafi Wan Husin	

Co-opted member

Mr Azme Sadon	Jabatan Bomba dan Penyelamat Malaysia
---------------	---------------------------------------

Preview Only

© Copyright 2012

All rights reserved. No part of this publication may be reproduced or utilised in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the Department of Standards Malaysia.